

---


---

**ADDENDUM NO. 1**

---

---

**NOTICE TO PROPOSERS:** This Addendum forms a part of the Contract Documents and modifies the original Specifications and Drawings for Las Cruces Public Schools Rio Grande Preparatory Institute Re-Roof, dated January 28, 2021.

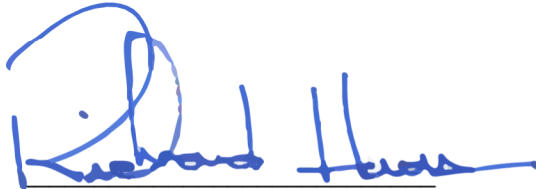

Richard M. Haas

April 26, 2021  
Date



**SPECIFICATIONS:**

**A) SECTION 00 1119 – REQUEST FOR PROPOSAL**

- 1) **CLARIFICATION: ATTACHMENT 3 – CHANGE “...TO RFP 20-21-06P” TO READ “...TO RFP 20-21-09P”.**

**B) SECTION 00 1119 – REQUEST FOR PROPOSAL**

- 1) **CLARIFICATION: ATTACHMENT 5: cont. – CHANGE “RFP No. 20-21-06P” TO READ “RFP 20-21-09P”.**
- 2) **CLARIFICATION: CHANGE “...no later than April 02, 2021 at 2:00 p.m. MST, and must not be...” TO READ “...no later than May 03, 2021 at 10:00 a.m. MST, and must not be ...”**

**ATTACHMENTS:**

1. **AMENDMENT ONE – Changes/Answers/Additional Documents and Information Answers.**

**END OF ADDENDUM NO. 1**

**AMEMDMENT ONE**  
**RFP 20-21-09P**  
**Release Date: 04/11/2021**

**Re-Solicitation Rio Grande Preparatory Institute Re-Roof Las Cruces**  
**Public Schools**

Amendment #1 is issued for the entitled RFP as a matter of answering questions asked during the question period.

**All Amendment(s) will be posted to the LCPS vendor registry website for download. Interested proposers are required to registry to view and download documents at <https://vrapp.vendorregistry.com/Vendor/Register/Index/las-cruces-public-school-district-purchasing-nm-vendor-registration> .**

**AMENDED CHANGES/ANSWERS /ADDITIONAL DOCUMENTS AND INFORMATION ARE AS FOLLOWS:**

*Q1. In reviewing the two basins for the trench drain system, there is not enough capacity for the area of roof that drains into this system. Please be aware that there is a high likelihood of overflow during a rain event of over ¼”.*

*A1. Currently, the rain that slopes to the East side of the original building does not drain and ponds over the existing sidewalk. The intent of the trench drain system is to divert this water away from the building and dump into the two catch basins. These catch basins will then overflow to the playground area to the East and the parking lot to the North. The selected general contractor shall verify all existing grading to ensure proper drainage of all water away from the building, including the overflow drainage.*

Regards,

*Cesar Chavez*

**Cesar Chavez**  
**Purchasing, Senior Buyer**